


TO BE INSTALLED AND FURNISHED BY CUSTOMER

1. 5/8" X 8' galvanized or copper coated ground rod with U.L. approved clamp.
2. Customer to supply 200 AMP meter base that is U.L. approved.
3. Number 6 copper ground.
4. Install ground rod to the left or right of meterbase to allow for trencher boom.



*** NOTE:**
Meter location must be spotted by LEC personnel prior to installation.

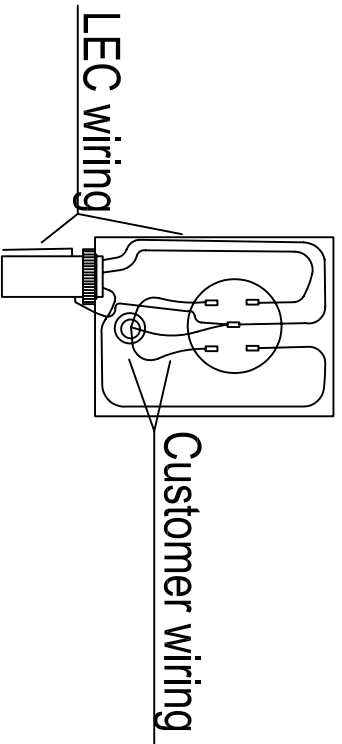